


THE LORD'S HOUSE - PASSY, SENEGAL
PLUMBING
GROUND FLOOR

- NOTES**
1. CONNECT TO CITY DISTRIBUTION MAIN APPROX. 190M EAST OF SITE.
 2. 50MM TAP OR 110 X 50MM TEE, ROATED DOWN 45°, RUN PIPE UNTIL IT IS AT 100CM DEPTH, PLACE 45° BEND TO MAKE PIPE HORIZONTAL AND RUN PIPE AT 70 CM DEPTH TO BUILDING, 110MM PIPE IS 40 CM BELOW GRADE.
 3. OFFSET SEPTIC AND WATER LINES BY 0.5M WHERE PARALLEL.
 4. AT BURIED SEPTIC/WATER CROSSINGS, ALWAYS RUN THE SEWER BELOW WATER LINE; WHEREVER THE CLEARANCE <M BETWEEN THE TWO PIPES, ENCASE THE CROSSING WITH CONCRETE.



SEE NOTES 1,2

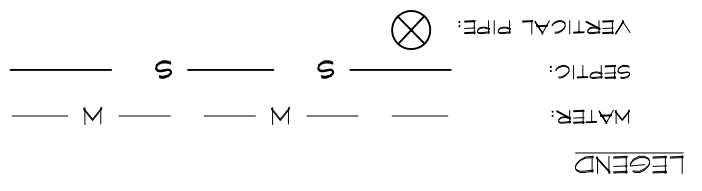